


- NOTES:
1. REDUCED PRESSURE ASSEMBLIES (RP) MUST CONFORM TO CITY OF CONCORD SPECIFICATIONS.
 2. A 4-INCH THICK CONCRETE PAD SHALL BE PROVIDED. SUPPORT PEDESTAL(S) SHALL BE PROVIDED AS NEEDED. SUPPORT PEDESTALS(S) SHALL NOT BLOCK RELIEF VALVE OR DRAIN PORT.
 3. PROTECTIVE ENCLOSURE SHALL CONFORM WITH ASSE1060 AND SHALL BE IN ACCORDANCE CITY OF CONCORD SPECIFICATIONS, ORDINANCE, AND BACKFLOW MANUAL.
 4. RIGID PIPE AND FITTINGS SHALL BE 3/4" TO 2" BRASS, K-COPPER, OR GALVANIZED PIPE.
 5. THE CITY OF CONCORD APPROVED 3/4" TO 2" RP INCLUDES SHUT OFF VALVES #1 AND #2. AS PART OF THE ASSEMBLY. NO SUBSTITUTIONS SHALL BE PERMITTED.
 6. TEST COCK #1 SHALL BE UPSTREAM OF SHUT OFF VALVE #1 AND IS PART OF THE APPROVED ASSEMBLY.

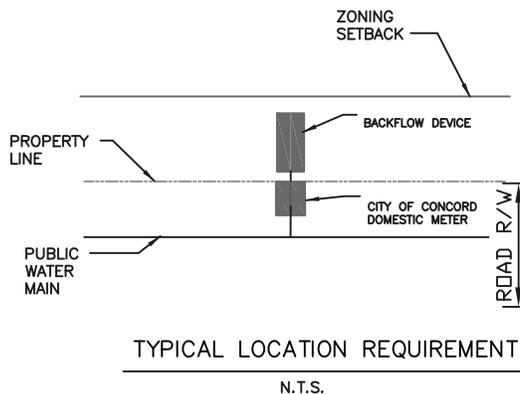

			STANDARD DETAIL BACKFLOW PREVENTION		
			ABOVE GROUND 3/4" INCH TO 2 INCH REDUCED PRESSURE ASSEMBLY (RP)		
3	9-13-07	SM	DOMESTIC DETAIL, PIPE EDITS		
2	8-30-06	SM	LOCATION DETAIL		
1	10-8-96	MP	PAD		
No.	Date	By	REVISION		
Drawn By:		Checked By:	Approved By:	Date	Sht of
MP/SVM				11/94	1 15