


GENERAL NOTES:

1. REFER TO THE CITY OF CONCORD SPECIFICATIONS FOR ACCEPTABLE MANUFACTURES OF MATERIALS.
2. PROVIDE 12" BRASS NIPPLE PAST BOX
3. METER BOXES SHALL BE PLASTIC BODY AND LID. THE METER HOUSING SHALL BE MID STATE PLASTICS OR EQUAL; 3/4-INCH BOX MSBCF - 1118-12XL AND LID MSCBC-1118- RTR; AND 1-INCH BOX MSBCF -1324-12XL AND LID MSCBC-1324- RTR. METER BOX RIM SHALL BE SET FLUSH WITH FINAL GRADE. THE WATER METER BOX ASSEMBLY SHALL NOT BE LOCATED WITHIN A ROAD, STREET, DRIVEWAY, SIDEWALK OR DRAINAGE FEATURE.
4. ALL APPURTENANCES FOR THE INSTALLATION OF THE WATER METER; THE METER, BRASS GROUND LOCKABLE METER CUTOFF, GASKETS, AND EXPANSION CONNECTION; SHALL BE INSTALLED BY THE CITY OF CONCORD, IF CONNECTION IS TO AN EXISTING MAIN.
5. REQUIRED BACKFLOW PREVENTION ASSEMBLY IN ACCORDANCE WITH THE CITY OF CONCORD CROSS-CONNECTION CONTROL ORDINANCE.
6. THE BASE OF THE METER BOX MUST HAVE AT LEAST 6-INCHES TO 8-INCHES OF #57 WASHED STONE.

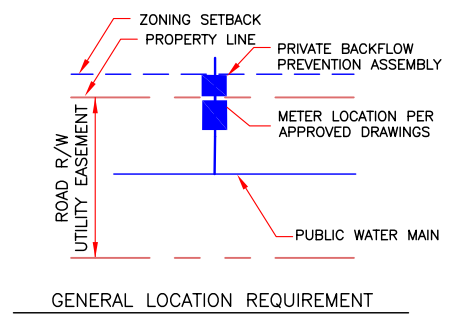

GENERAL LOCATION REQUIREMENT
N.T.S.
FINAL METER LOCATION TO BE IN COMPLIANCE WITH THE APPROVED DRAWINGS & CITY OF CONCORD ORDINANCE

		WATER METER STANDARD DETAIL			
		3/4-INCH AND 1-INCH IRRIGATION OR COMMERCIAL WATER SERVICE METER			
1.	9/7/07	By	CONTINUOUS PIPE & CONNECTION, SVM		
No.	Date	By	REVISION		
Drawn By:		Checked By:	Approved By:	Date	Sht of
				02/05	