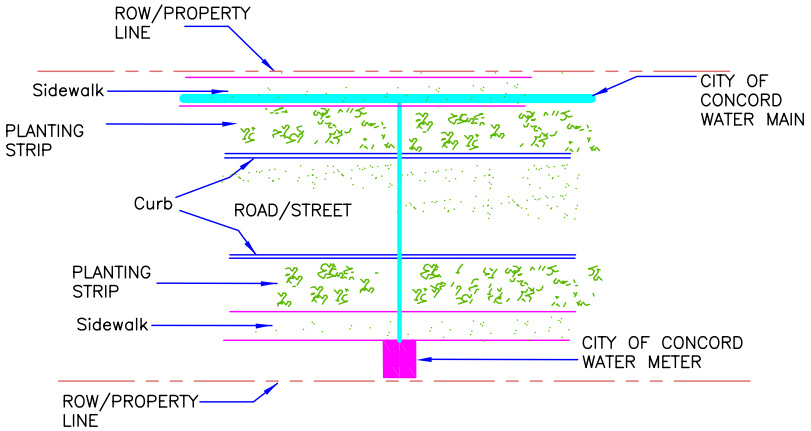

TYPICAL LOCATION REQUIREMENT
LONG SIDE TAP

N.T.S.

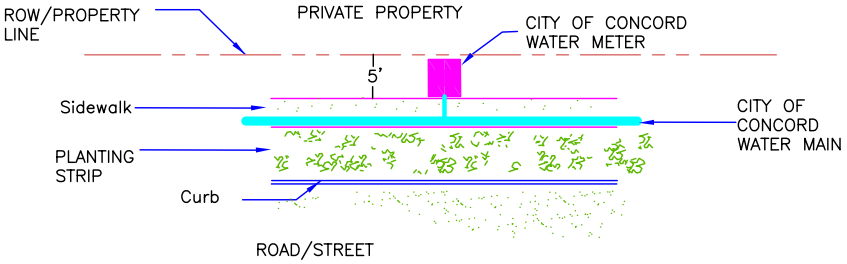

TYPICAL LOCATION REQUIREMENT
SHORT SIDE TAP

N.T.S.

GENERAL NOTES:

1. PUBLIC UTILITY EASEMENT SHALL BE LOCATED AT LEAST 5-FEET BEYOND THE BACK EDGE OF THE SIDEWALK ON THE PRIVATE SERVICE SIDE OF THE WATER METER.
2. SERVICE PIPE MATERIAL SHALL BE K-COPPER WITH BRASS FITTINGS FROM WATER MAIN TO WATER METER.
4. WHEN WATER AND SEWER SERVICES ARE EXTENDED FROM MAINS LOCATED WITHIN THE ROAD RIGHT-OF-WAY, SEWER SERVICE LATERALS SHALL BE LOCATED AT THE CENTER OF THE LOT AND THE WATER SERVICE SHALL BE LOCATED FIVE FEET TO THE RIGHT OF THE SEWER SERVICE LATERAL.
5. UNDER NO CIRCUMSTANCE SHALL THE WATER METER BE LOCATED IN A DRIVEWAY.

CONCORD
NORTH CAROLINA
a city meeting the future...

WATER METER
STANDARD DETAIL

3/4-INCH OR 1-INCH
DOMESTIC WATER METER
TYPICAL LOCATION

No.	Date	By	REVISION

Drawn By:	Checked By:	Approved By:	Date	Sht	of
SM	PLK	MSH	02/05		